



Finite Element Design and Crack–Deflection Verification of Reinforced Concrete Floor Slabs

Huu-Dien Nguyen*

Long An University of Economics and Industry, Vietnam

Correspondence: E-mail: nguyen.dien@daihoclongan.edu.vn

ABSTRACT

This paper presents the design and verification of reinforced concrete floor slabs using the finite element method (FEM). The study focuses on a multi-story residential building located in Ho Chi Minh City, Vietnam. Structural analysis was performed to determine internal forces, reinforcement requirements, and serviceability checks including cracking and deflection. The floor system was modeled as two-way slabs supported by beams and columns, subjected to dead load, live load, and wall loads according to TCVN 2737:2023. The results show that the slabs satisfy strength, crack, and deflection requirements. FEM analysis confirms that the adopted slab thickness and reinforcement layout ensure both safety and serviceability under design loads.

© 2026 Bumi Publikasi Nusantara

ARTICLE INFO

Article History:

Submitted/Received 20 Oct 2025

First Revised 19 Nov 2025

Accepted 20 Dec 2025

First Available online 21 Dec 2025

Publication Date 01 Sep 2026

Keyword:

*Cracking,
Deflection,
Finite element method,
Reinforced concrete slab,
Structural design.*

1. INTRODUCTION

The rapid development of urban areas in Vietnam, particularly Ho Chi Minh City, has led to a growing demand for high-rise residential buildings (Seo & Kwon, 2017; Nguyen *et al.*, 2017; Liang *et al.*, 2025; Chung *et al.*, 2018; Nguyen *et al.*, 2025). Structural safety and serviceability of reinforced concrete slabs play a crucial role in ensuring durability and comfort for occupants (Krentowski, 2021; Yu *et al.*, 2022; Pavic & Reynolds, 2022; Gholamhoseini *et al.*, 2016; Biradar *et al.*, 2024; Safi *et al.*, 2025). Traditional calculation methods provide simplified results, while the finite element method (FEM) offers a more accurate prediction of stresses, deflections, and cracking behavior (Alshoaibi & Fageehi, 2024; Teng *et al.*, 2021; Mohamad *et al.*, 2025; Wu *et al.*, 2025; Soltanpour & Sheikhi, 2025; Pereira *et al.*, 2025; Kumar *et al.*, 2025; Gindy *et al.*, 2025).

This paper presents the design and verification of floor slabs for a nine-story reinforced concrete building. The study emphasizes the use of FEM for internal force determination, reinforcement detailing, and serviceability checks including cracking and deflection limits.

2. METHODS

2.1. Project Overview

The case study building is a nine-story reinforced concrete residential building with a basement, located in Ho Chi Minh City. The building has a structural height of 38.3 m with a floor grid of 9 m span. The structural system consists of a reinforced concrete frame with monolithic beam-slab construction (see Figure 1).

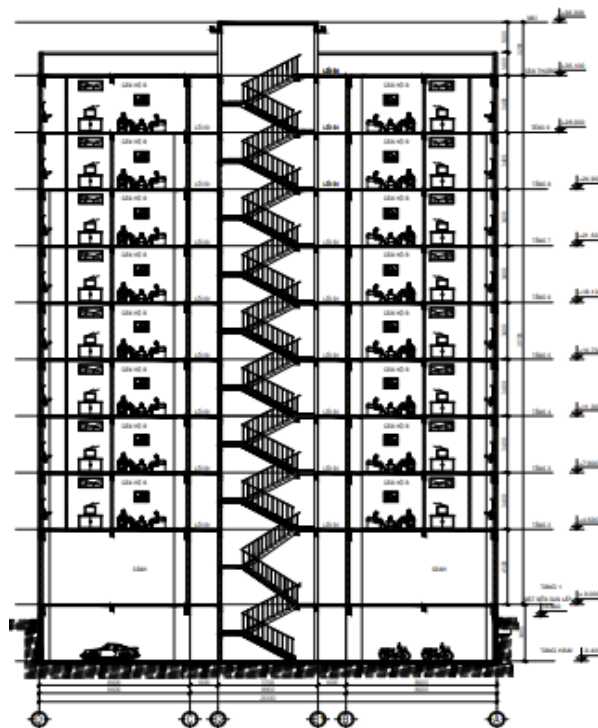


Figure 1. The structural system.

2.2. Materials

The materials are:

- (i) Concrete: Grade B30, compressive strength $R_b = 17$ MPa, tensile strength $R_{bt} = 1.15$ MPa, modulus of elasticity $E_b = 32.5 \times 10^3$ MPa.

- (ii) Reinforcement: CB300-V and CB400-V steel, with tensile strength $R_s = 260$ MPa and modulus of elasticity $E_s = 200 \times 10^3$ MPa.

2.3. Finite Element Modelling

The slabs were modeled as two-way plates supported on beams and columns. Dead load was determined from slab self-weight and finishing layers, while live loads were assigned according to TCVN 2737:2023. Equivalent wall loads were distributed on slabs without supporting beams. FEM analysis was conducted to compute bending moments, shear forces, and deflections.

2.4. Design Procedure

Design procedure are including several parts as follow.

- (i) Load Calculation: Dead load, superimposed dead load, and live load were calculated.
- (ii) Internal Force Analysis: FEM was used to obtain bending moments and shear forces for each slab panel.
- (iii) Reinforcement Design: Slab reinforcement was designed according to TCVN 5574:2018, ensuring adequate flexural strength.
- (iv) Crack and Deflection Checks: Crack control was performed using crack moment calculations, while deflections were checked against serviceability criteria.

3. RESULTS AND DISCUSSION

3.1. Load Analysis

The total design load for the critical slab panel (S9, 4.50×4.25 m) was determined as $q = 9.74$ kN/m², including slab self-weight, finishing loads, and wall loads (see **Figure 2**).

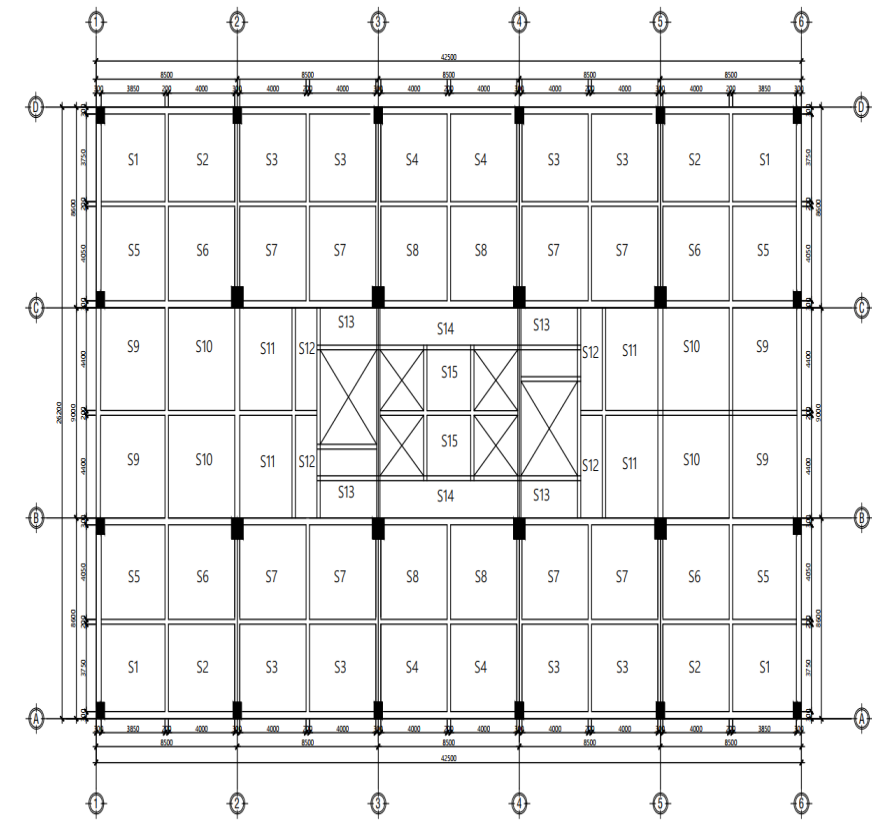


Figure 2. Symbols of slab panels.

3.2. FEM Internal Forces

For slab S9, FEM analysis yielded mid-span bending moments $M_x = 8.18 \text{ kNm/m}$ and $M_y = 7.24 \text{ kNm/m}$. Edge negative moments were also obtained, confirming continuity effects (Figures 3 and 4).

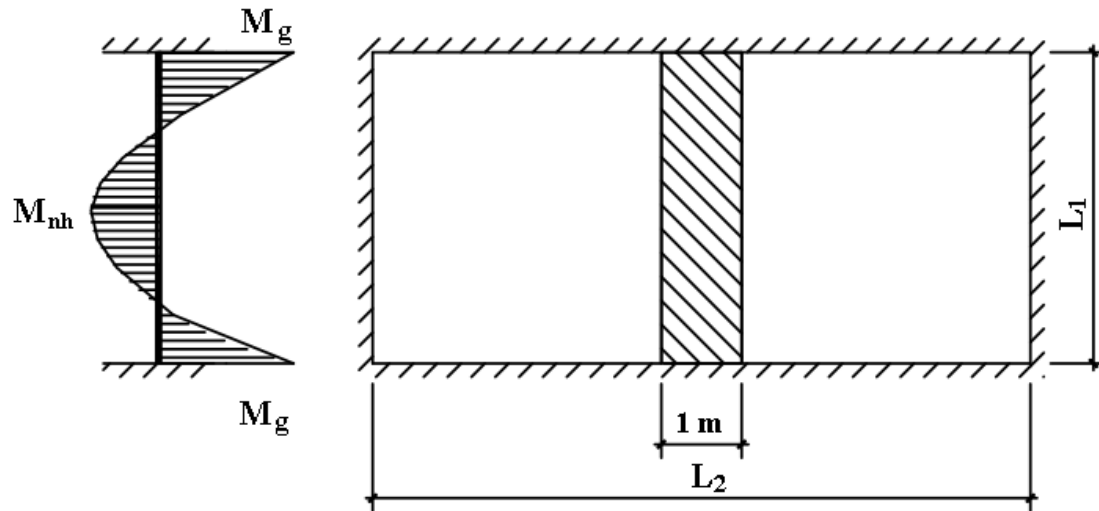


Figure 3. One-way slab diagram.

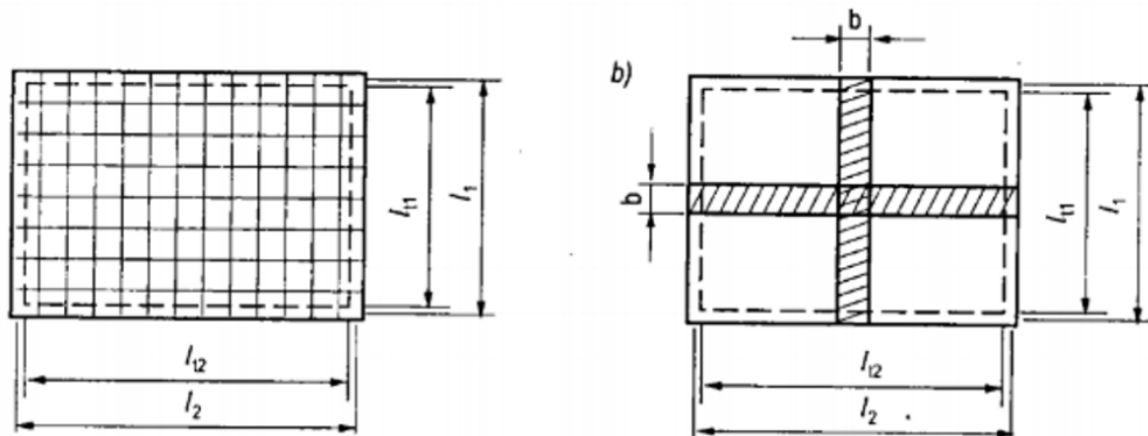


Figure 4. Two-way slab diagram.

3.3. Reinforced Layout

Based on flexural analysis, reinforcement requirements were satisfied with:

- (i) Bottom reinforcement: $\Phi 10@200 \text{ mm}$ in both directions.
- (ii) Top reinforcement at supports: $\Phi 10@200 \text{ mm}$.

The reinforcement ratios were within permissible limits, and steel stresses were below yield.

3.4. Crack Control

The crack resistance check was carried out for slab S9. The cracking moment was calculated as $M_{cr} = 7.5 \text{ kNm}$, while the applied design moment was $M_{tc} = 2.67 \text{ kNm}$. Since $M_{tc} < M_{cr}$, no cracks are expected under service loads.

3.5. Deflection Verification

Deflections were verified using FEM results and serviceability criteria. The calculated maximum deflection did not exceed $L/250$, satisfying code requirements.

3.6. Shear Capacity

Shear verification showed that the design shear force $Q=19.58$ kN was less than the concrete shear capacity $Q_b=55.2$ kN. Thus, punching shear and one-way shear failure are unlikely (see **Table 1**).

Table 1. Mid-span and support moments of a two-way slab supported on four edges.

Slab Panel	Size		Load		Ratio	Moment Coefficient	Moment	
	l_1 (m)	l_2 (m)	g (kN/m ²)	p (kN/m ²)			Value	Value
					P (kN)	l_2/l_1		(kN·m/m)
S1	4.25	4.15	4.90	1.95	120.82	1.02	m_{g1}	0.0182
							m_{g2}	0.0176
							k_{g1}	0.0425
							k_{g2}	0.0408
S2	4.25	4.15	4.90	1.95	120.82	1.02	m_{g1}	0.0182
							m_{g2}	0.0176
							k_{g1}	0.0425
							k_{g2}	0.0408
S3	4.25	4.15	6.56	2.60	161.56	1.02	m_{g1}	0.0182
							m_{g2}	0.0176
							k_{g1}	0.0425
							k_{g2}	0.0408
S4	4.25	4.15	6.16	2.60	154.50	1.02	m_{g1}	0.0182
							m_{g2}	0.0176
							k_{g1}	0.0425
							k_{g2}	0.0408
S5	4.45	4.25	6.31	2.60	168.51	1.04	m_{g1}	0.0185
							m_{g2}	0.0173
							k_{g1}	0.0433
							k_{g2}	0.0399
S6	4.45	4.25	6.56	1.95	160.89	1.04	m_{g1}	0.0185
							m_{g2}	0.0173
							k_{g1}	0.0433
							k_{g2}	0.0399
S7	4.45	4.25	6.49	1.95	159.56	1.04	m_{g1}	0.0185
							m_{g2}	0.0173
							k_{g1}	0.0433
							k_{g2}	0.0399
S8	4.45	4.25	6.49	1.95	159.56	1.04	m_{g1}	0.0185
							m_{g2}	0.0173
							k_{g1}	0.0433
							k_{g2}	0.0399
S9	4.50	4.25	7.14	2.60	186.22	1.06	m_{g1}	0.0188
							m_{g2}	0.0169
							k_{g1}	0.0439
							k_{g2}	0.0389
S10	4.50	4.25	7.07	1.95	172.51	1.06	m_{g1}	0.0188
							m_{g2}	0.0169
							k_{g1}	0.0439

Table 1 (continue). Mid-span and support moments of a two-way slab supported on four edges.

Slab Panel	Size		Load		Ratio	Moment Coefficient	Moment		Moment	Value
	l_1 (m)	l_2 (m)	g (kN/m ²)	p (kN/m ²)			Coefficient	Value	Moment	Value (kN·m/m)
S11	4.50	3.40	4.90	3.90	1.30	1.30	k_{92}	0.0389	M''	6.71
							m_{91}	0.0208	M_1	2.80
							m_{92}	0.0123	M_2	1.66
							k_{91}	0.0475	M'	6.40
							k_{92}	0.0281	M''	3.78
S15	2.90	2.80	4.90	3.90	1.03	1.03	m_{91}	0.0184	M_1	1.31
							m_{92}	0.0174	M_2	1.24
							k_{91}	0.0429	M'	3.07
							k_{92}	0.0403	M''	2.88

4. CONCLUSION

This study applied the finite element method to analyze and design reinforced concrete floor slabs for a high-rise building in Ho Chi Minh City. The results confirm that:

- (i) The FEM provides reliable internal force distribution for two-way slabs.
- (ii) Designed reinforcement ensures both strength and ductility under applied loads.
- (iii) Serviceability requirements, including crack control and deflection limits, are satisfied.
- (iv) The adopted slab thickness (120 mm) and reinforcement arrangement are adequate for safety and comfort.

The methodology presented in this paper can be applied to similar reinforced concrete structures, contributing to safe and efficient slab design in urban residential buildings.

5. ACKNOWLEDGMENT

The authors wish to acknowledge the DLA for supporting this work.

6. AUTHORS' NOTE

The authors declare that there is no conflict of interest regarding the publication of this article. Authors confirmed that the paper was free of plagiarism.

7. REFERENCES

- Seo, D., and Kwon, Y. (2017). In-migration and housing choice in Ho Chi Minh City: Toward sustainable housing development in Vietnam. *Sustainability*, 9(10), 1738.
- Nguyen, T. B., van der Krabben, E., Spencer, J. H., and Truong, K. T. (2017). Collaborative development: Capturing the public value in private real estate development projects in Ho Chi Minh City, Vietnam. *Cities*, 68, 104-118.
- Liang, Y., Zhang, J., Sun, W., Guo, Z., and Li, S. (2025). Tracking the construction land expansion and its dynamics of Ho Chi Minh City Metropolitan area in Vietnam. *Land*, 14(6), 1253.
- Chung, Y. S., Seo, D., and Kim, J. (2018). Price determinants and GIS analysis of the housing market in Vietnam: the cases of Ho Chi Minh City and Hanoi. *Sustainability*, 10(12), 4720.

- Nguyen, L. P., van den Berg, P. E., Kemperman, A. D., and Mohammadi, M. (2025). Social impacts of living in high-rise apartment buildings: The effects of buildings and neighborhoods. *Journal of urban affairs*, 47(8), 2894-2915.
- Krentowski, J. R. (2021). Assessment of destructive impact of different factors on concrete structures durability. *Materials*, 15(1), 225.
- Yu, X., Shi, Y., Pang, Y. K., and Lau, K. F. (2022). Resistance and serviceability assessment of innovative composite slab exposed to standard compartment fire. *Engineering Structures*, 270, 114861.
- Pavic, A., and Reynolds, P. (2002). Vibration serviceability of long-span concrete building floors. Part 1: Review of background information. *Shock and Vibration Digest*, 34(3), 191-211.
- Gholamhoseini, A., Khanlou, A., MacRae, G., Scott, A., Hicks, S., and Leon, R. (2016). An experimental study on strength and serviceability of reinforced and steel fibre reinforced concrete (SFRC) continuous composite slabs. *Engineering Structures*, 114, 171-180.
- Biradar, G., Ramanna, N., and Madduru, S. R. C. (2024). An in-depth examination of fire-related damages in reinforced concrete structures-A review. *Journal of Building Pathology and Rehabilitation*, 9(1), 81.
- Safi, H. U., Ayaz, M. H., Sahak, S. Z., and Haibat, M. S. (2025). A comparative seismic & cost analysis of rcc and steel frame structures of residential building: A case study for Kabul, Afghanistan. *Analecta Technica Szegedinensia*, 19(2), 1-14.
- Alshoaibi, A. M., and Fageehi, Y. A. (2024). Advances in finite element modeling of fatigue crack propagation. *Applied Sciences*, 14(20), 9297.
- Teng, G., Zheng, C., Chen, X., Lan, X., Zhu, Y., and Shan, C. (2021). Numerical fracture investigation of single-edge notched asphalt concrete beam based on random heterogeneous FEM model. *Construction and Building Materials*, 304, 124581.
- Mohamad, R., Wardeh, G., Kousa, M. A. A. A., and Jahami, A. (2025). 1D Finite element modeling of bond-slip behavior and deflection in reinforced concrete flexural members. *Designs*, 9(3), 75.
- Wu, Y., Chen, Y., Zeng, J., Jiang, Y., and Liu, Z. (2025). Long-term performance analysis of steel-concrete composite beams based on finite element model updating. *Buildings*, 15(8), 1374.
- Soltanpour, S., and Sheikhi, M. (2025). Numerical and finite element analysis of rc beams strengthened with a novel technique using external plates and rebars. *Advances in Civil Engineering*, 2025(1), 8815587.
- Pereira, W. M., Araújo, D. D. L., Cândido, E. A. D. S., Lobo, F. A., and Pituba, J. J. D. C. (2025). Parametric identification hybrid metaheuristic-based approach for steel fiber-reinforced concrete using finite element modeling: a comparative study. *Matéria (Rio de Janeiro)*, 30, e20250262.
- Kumar, S. D. A., Manggapis, F. F., Lucena, J. R. P. G., and Carabbacan, A. P. I. (2025). Investigation of the flexural capacity of glue-laminated *Bambusa spinosa* Roxb. beams

using an experimental procedure and finite element analysis. *Advances in Bamboo Science*, 100183.

Gindy, M., Abbas, M. M., Muntean, R., and Butnariu, S. (2025). Hybrid topology optimization of a concrete structure via finite element analysis and deep learning surrogates. *CivilEng*, 6(4), 68.